

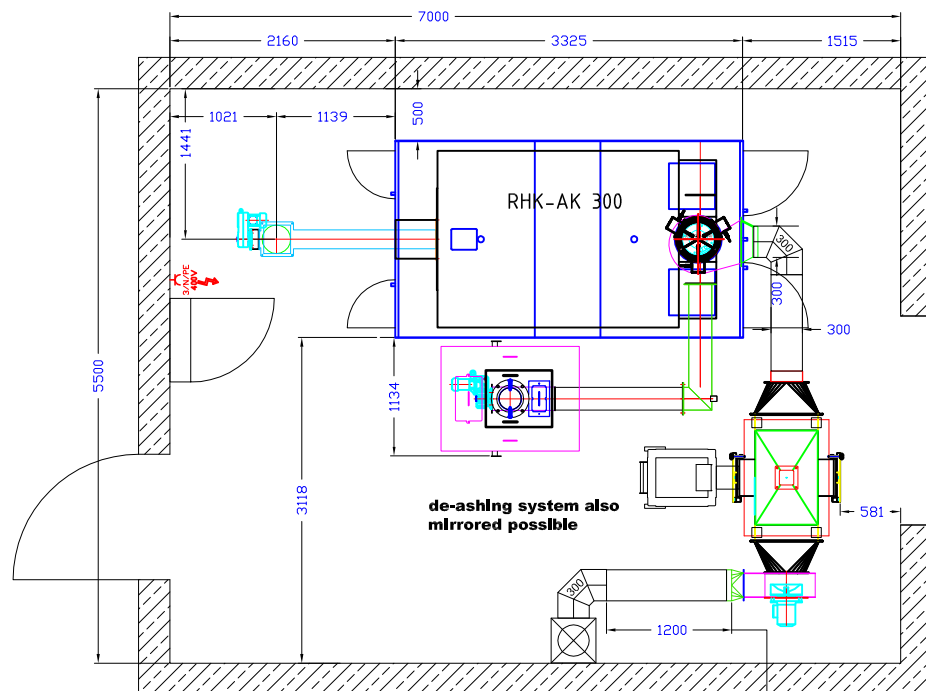


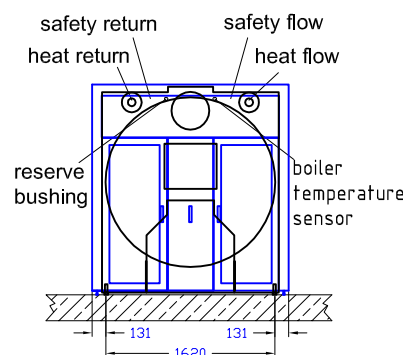

The necessary flue gas connections have to be made on site.

The straight measuring section 4x flue pipe diameter.

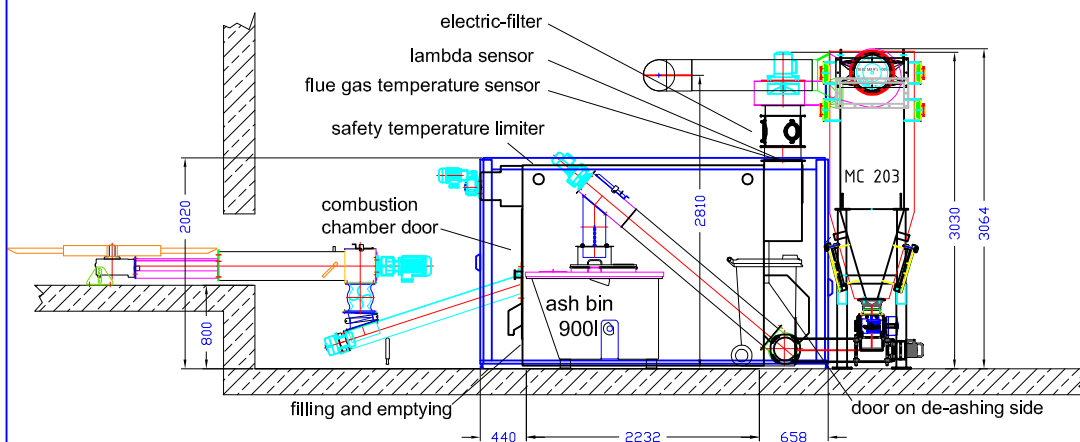

Electrical connection data Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

Technical data RHK-AK 300

e-filter/ Cyclone with separate de-ashing

transport width (mm)	1692
transport length (mm)	3030
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3325
height with cover panel (mm)	2020
water content (l)	1258
weight (kg)	5400
heat exchanger surface (m²)	29,70
continuous heat load (kW)	*270 / **240
*wood chips/ **pellets	
nominal heat load (kW)	325
CO² (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,250000
flue gas temperature (°C)	180
flue depress (PA)	24
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	126,90
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	300
min. opening for air supply (cm²)	650
min. volume flow rate for return temp. increase at 15K (m³/h)	5,73

Technical data cyclone MC203

transport width (mm)	1025
transport length (mm)	1212
transport height (mm)	2580
weight (kg)	700

Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

Heizomat

Heizomat GmbH Gerätebau- Energiesysteme
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

The boiler should be accessible from three sides. The discharging system should not cross the heating room.
Room height and position of the particle separator(s)* should be discussed with the Heizomat team.
Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" *.

Technical changes that serve the permanent further development remain reserved.

*Optional equipment, depending on the statutory provisions for the country of destination.

Status 01.07.2017

Electrical connection data Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

Technical data RHK-AK 300

e-filter/ cyclone with de-ashing

transport width (mm)	1692
transport length (mm)	3030
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3325
height with cover panel (mm)	2020
water content (l)	1258
weight (kg)	5400
heat exchanger surface (m ²)	29,70
continuous heat load (kW)	*270 / **240
*wood chips/ **pellets	
nominal heat load (kW)	325
CO ² (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,250000
flue gas temperature (°C)	180
flue depress (PA)	24
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	126,90
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	300
min. opening for air supply (cm ²)	650
min. volume flow rate for return temp. increase at 15K (m ³ /h)	5,73

Technical data cyclone MC203


transport width (mm)	1025
transport length (mm)	1212
transport height (mm)	2580
weight (kg)	700

Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

Heizomat

Heizomat GmbH Gerätebau- Energiesysteme
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

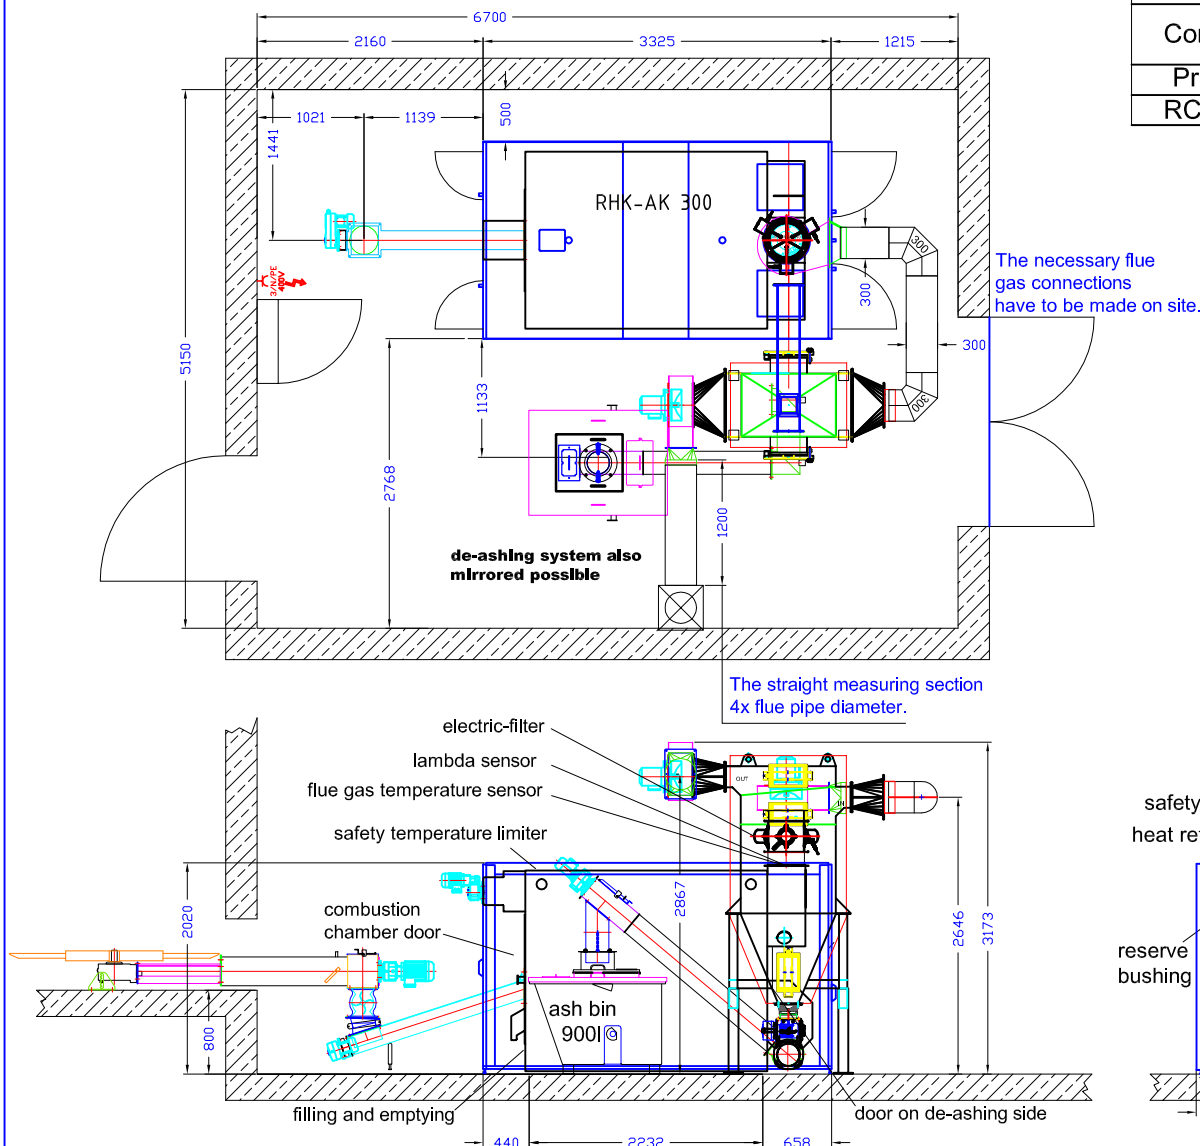

The boiler should be accessible from three sides. The discharging system should not cross the heating room.
Room height and position of the particle separator(s)* should be discussed with the Heizomat team.
Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" *.

Technical changes that serve the permanent further development remain reserved.

*Optional equipment, depending on the statutory provisions for the country of destination.

Status 01.07.2017

Electrical connection data




Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

Technical data RHK-AK 300

with e-filter

transport width (mm)	1692
transport length (mm)	3030
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3325
height with cover panel (mm)	2020
water content (l)	1258
weight (kg)	5400
heat exchanger surface (m ²)	29,70
continuous heat load (kW)	*270 / **240
*wood chips/ **pellets	
nominal heat load (kW)	325
CO ² (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,250000
flue gas temperature (°C)	180
flue depress (PA)	24
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	126,90
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	300
min. opening for air supply (cm ²)	650
min. volume flow rate for return temp. increase at 15K (m ³ /h)	5,73

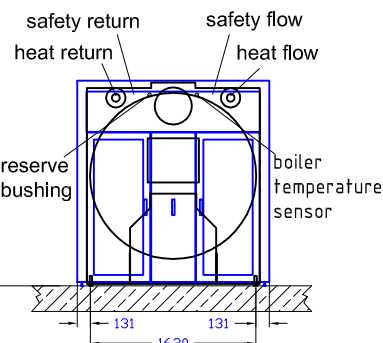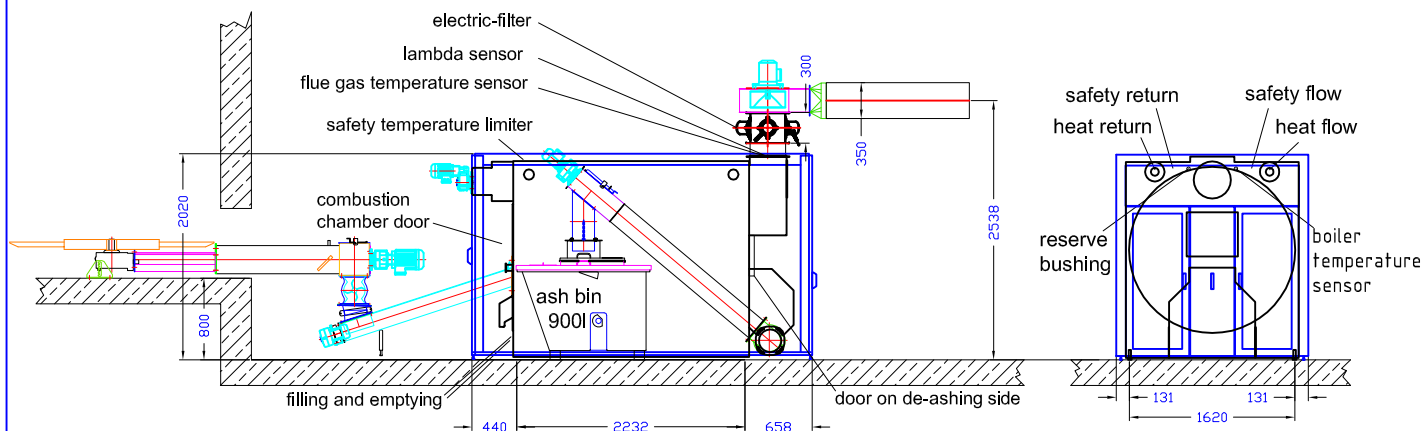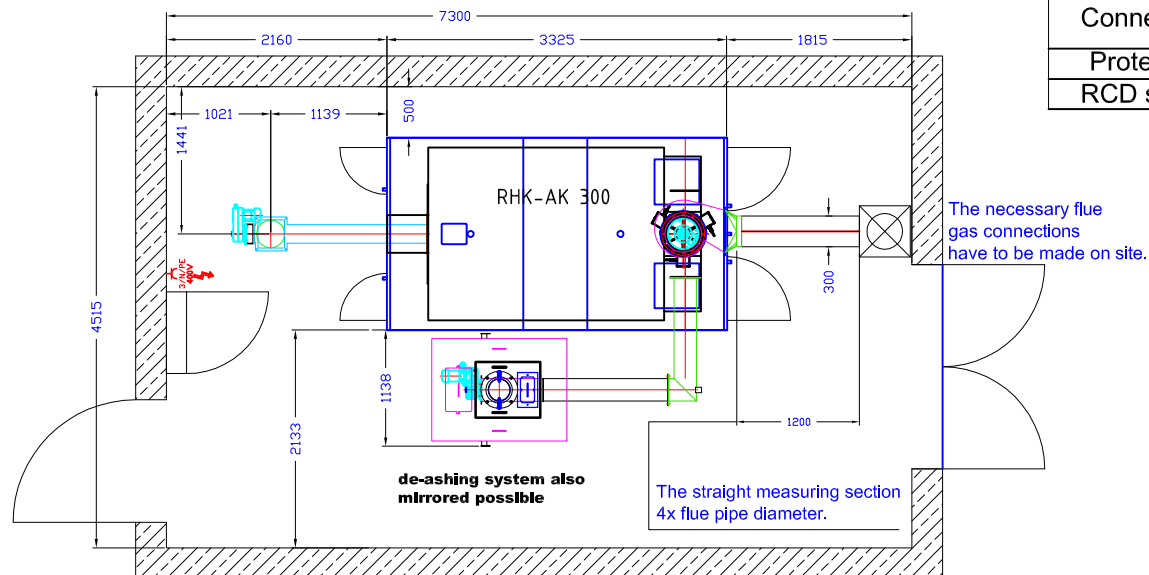

Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

Heizomat

Heizomat GmbH Gerätebau- Energiesysteme
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

Status 01.07.2017

The boiler should be accessible from three sides. The discharging system should not cross the heating room. Room height and position of the particle separator(s)* should be discussed with the Heizomat team. Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" *.

Technical changes that serve the permanent further development remain reserved.

*Optional equipment, depending on the statutory provisions for the country of destination.

Electrical connection data




Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

Technical data RHK-AK 300

without e-filter

transport width (mm)	1692
transport length (mm)	3030
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3325
height with cover panel (mm)	2020
water content (l)	1258
weight (kg)	5400
heat exchanger surface (m²)	29,70
continuous heat load (kW)	*270 / **240
*wood chips/ **pellets	
nominal heat load (kW)	325
CO² (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,250000
flue gas temperature (°C)	180
flue depress (PA)	24
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	126,90
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	300
min. opening for air supply (cm²)	650
min. volume flow rate for return temp. increase at 15K (m³/h)	5,73

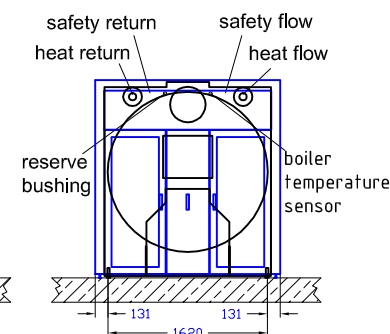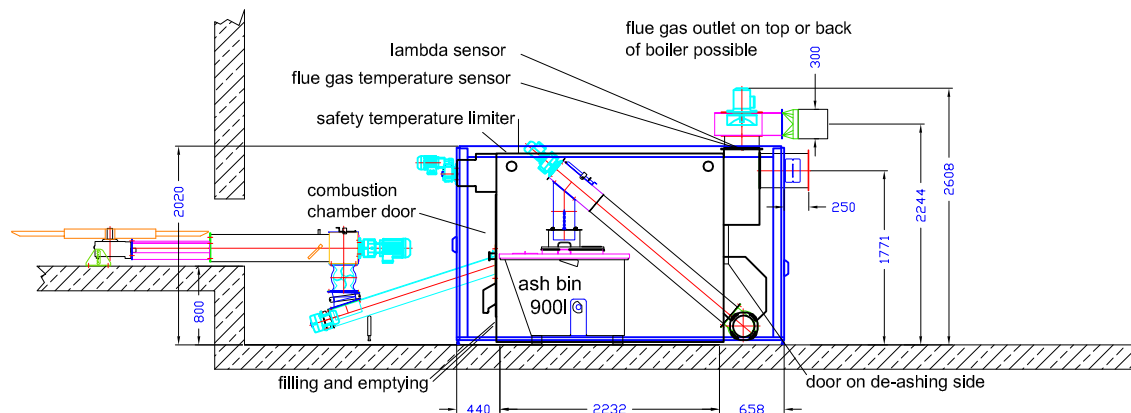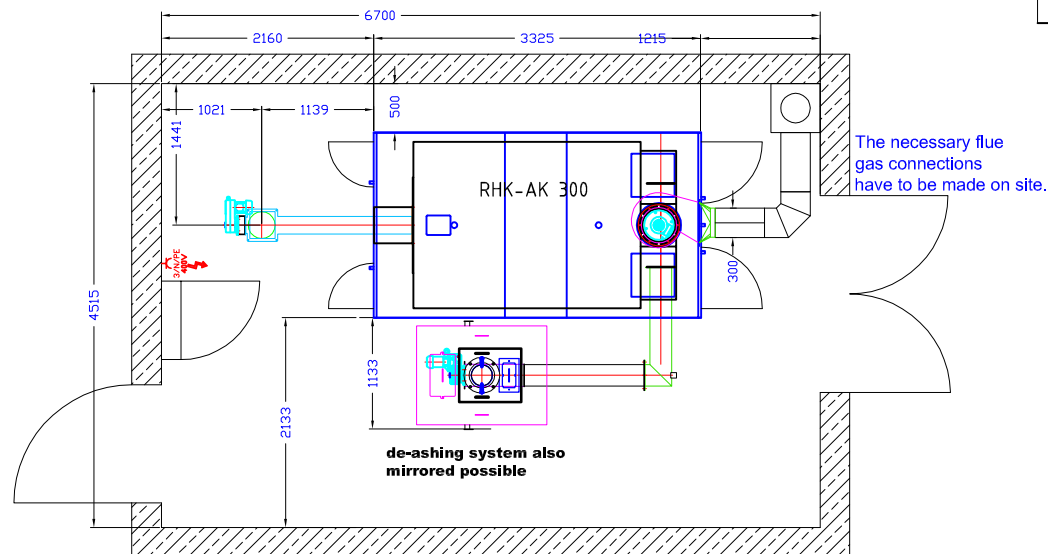

The boiler should be accessible from three sides. The discharging system should not cross the heating room. Room height and position of the particle separator(s)* should be discussed with the Heizomat team. Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" *.

Technical changes that serve the permanent further development remain reserved.

*Optional equipment, depending on the statutory provisions for the country of destination.

Status 01.07.2017



Heizomat GmbH Gerätebau- Energiesysteme
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

Electrical connection data



Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

Technical data RHK-AK 300

e-filter and cyclone

transport width (mm)	1692
transport length (mm)	3030
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3325
height with cover panel (mm)	2020
water content (l)	1258
weight (kg)	5400
heat exchanger surface (m²)	29,70
continuous heat load (kW)	*270 / **240
*wood chips/ **pellets	
nominal heat load (kW)	325
CO² (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,250000
flue gas temperature (°C)	180
flue depress (PA)	24
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	126,90
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	300
min. opening for air supply (cm²)	650
min. volume flow rate for return temp. increase at 15K (m³/h)	5,73

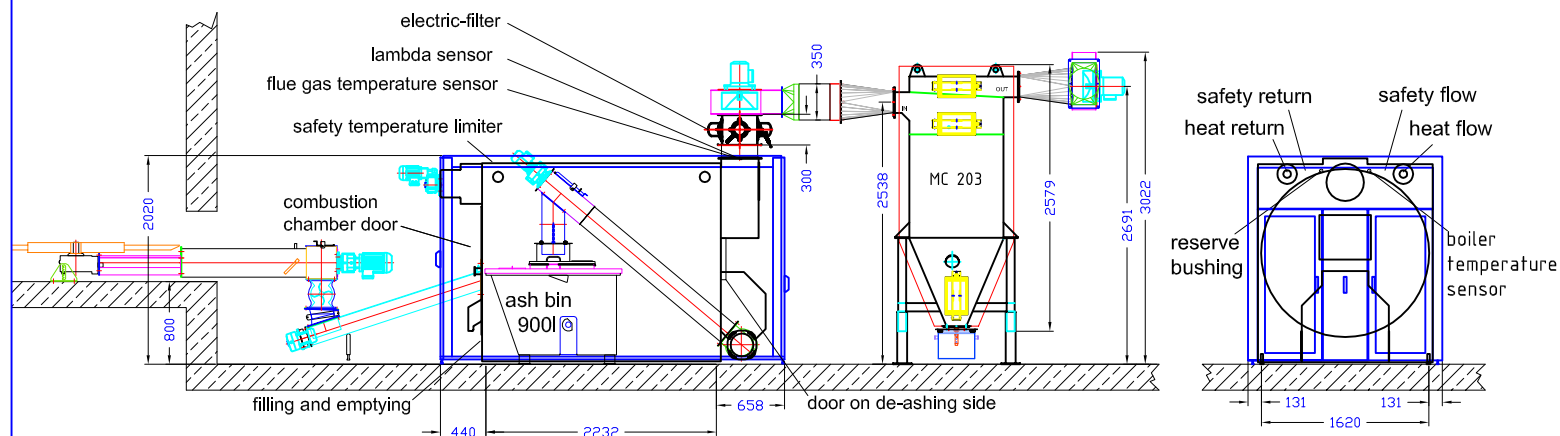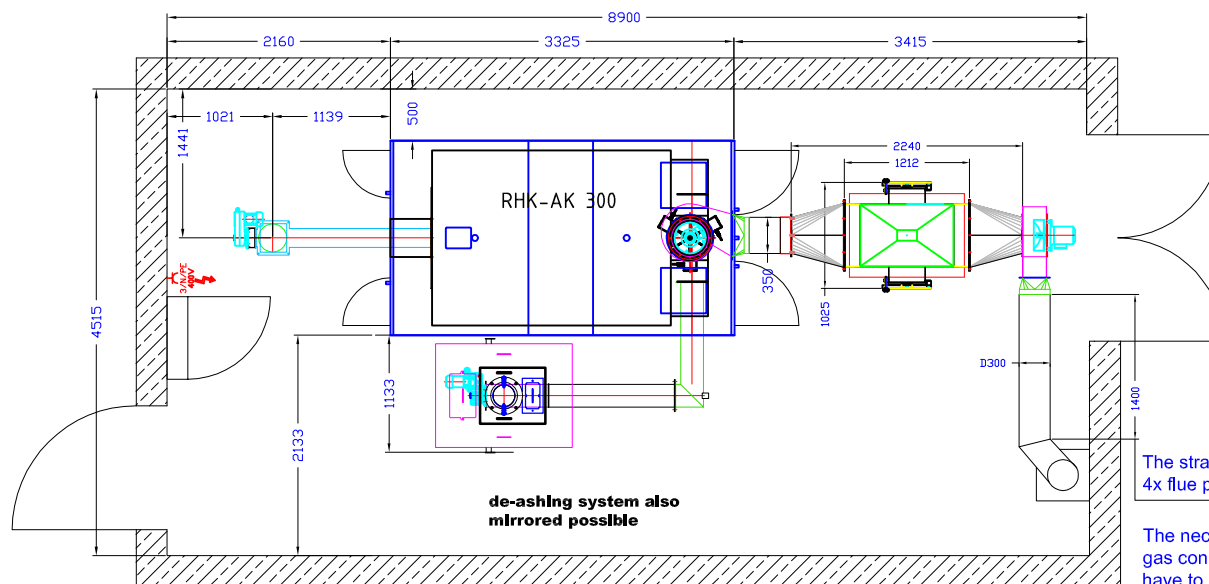

The boiler should be accessible from three sides. The discharging system should not cross the heating room.
Room height and position of the particle separator(s)* should be discussed with the Heizomat team.
Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" *.

Technical changes that serve the permanent further development remain reserved.

*Optional equipment, depending on the statutory provisions for the country of destination.

Technical data cyclone MC203

transport width (mm)	1025
transport length (mm)	1212
transport height (mm)	2580
weight (kg)	700

Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

Heizomat

Heizomat GmbH Gerätebau- Energiesysteme
Maicha 21 - 91710 Gunzenhausen - 09386/9797-0

Status 01.07.2017