


## Electrical connection data Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

## Technical data RHK-AK 400 e-filter/ Cyclone with separate de-ashing

transport width (mm)	1692
transport length (mm)	3530
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3825
height with cover panel (mm)	2020
water content (l)	1580
weight (kg)	6200
heat exchanger surface (m <sup>2</sup> )	33,75
continuous heat load (kW) *wood chips/ **pellets	*360 / **320
heating output (kW)	400
CO <sub>2</sub> (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,330000
flue gas temperature (°C)	180
flue depress (PA)	28
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	162,30
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	350
min. opening for air supply (cm <sup>2</sup> )	850
min. volume flow rate for return temp. increase at 15K (m <sup>3</sup> /h)	7,64

## Technical data cyclone MC203

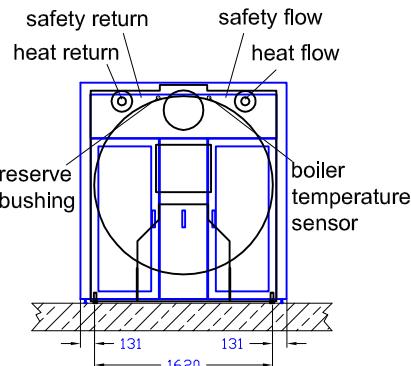

## Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

**Heizomat**


The boiler should be accessible from three sides. The discharging system should not cross the heating room.

Room height and position of the particle separator(s)\* should be discussed with the Heizomat team.

Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" \*.

Technical changes that serve the permanent further development remain reserved.

\*Optional equipment, depending on the statutory provisions for the country of destination.

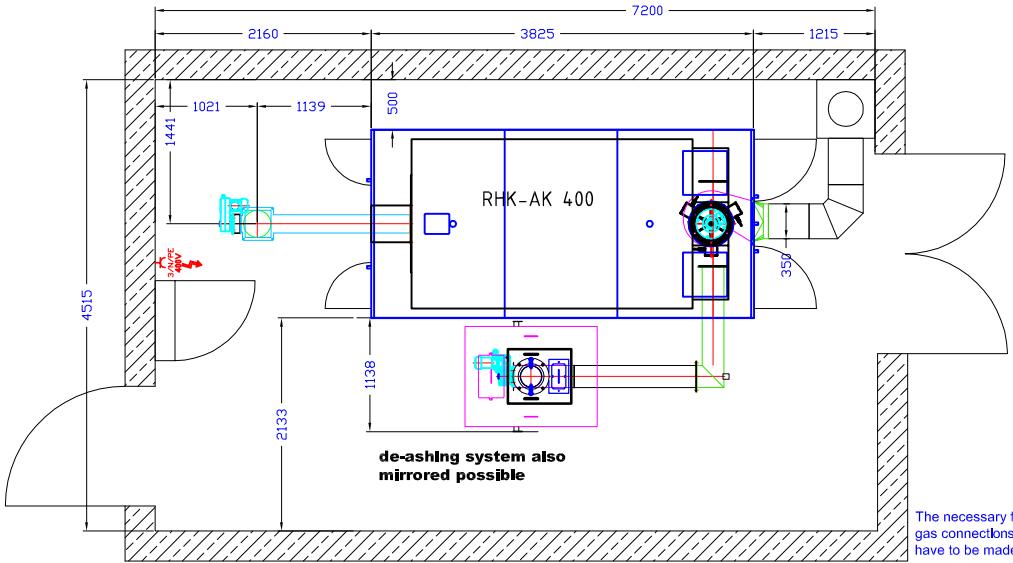


### Electrical connection data Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A $\Delta N$ 300mA

### Technical data RHK-AK 400 without e-filter

transport width (mm)	1692
transport length (mm)	3530
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3825
height with cover panel (mm)	2020
water content (l)	1580
weight (kg)	6200
heat exchanger surface ( $m^2$ )	33,75
continuous heat load (kW) *wood chips/ **pellets	*360 / **320
heating output (kW)	400
$CO_2$ (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,330000
flue gas temperature ( $^{\circ}C$ )	180
flue depress (PA)	28
flue depress with underpressure monitoring (PA)	10
drop at $dT$ 10 pressure K (mbar)	162,30
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	350
min. opening for air supply ( $cm^2$ )	850
min. volume flow rate for return temp. increase at 15K ( $m^3/h$ )	7,64

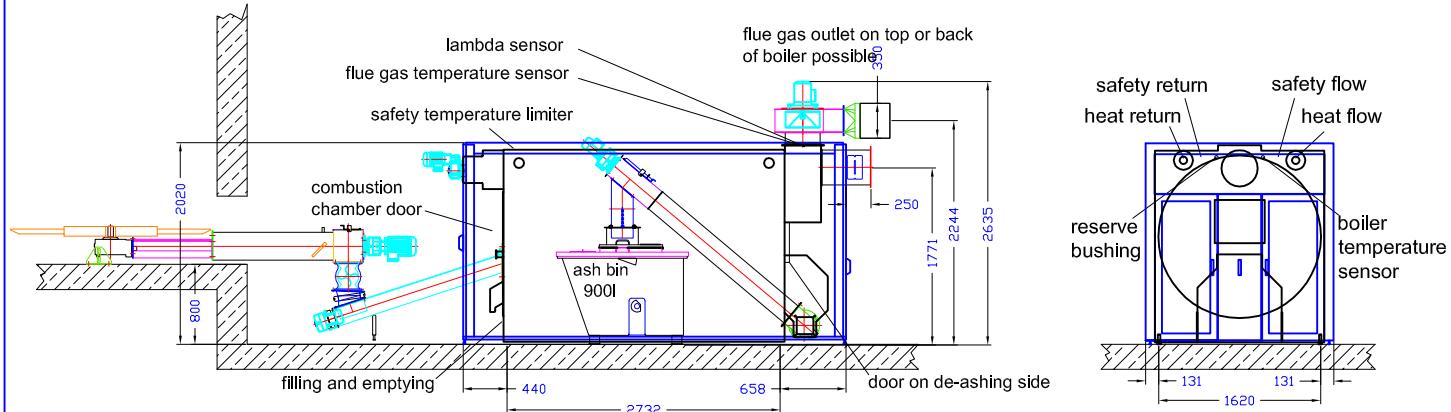

The boiler should be accessible from three sides. The discharging system should not cross the heating room.

Room height and position of the particle separator(s)\* should be discussed with the Heizomat team.


Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" \*.

Technical changes that serve the permanent further development remain reserved.

\*Optional equipment, depending on the statutory provisions for the country of destination.

Status 01.07.2017

Heizomat GmbH Gerätebau- Energiesysteme  
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

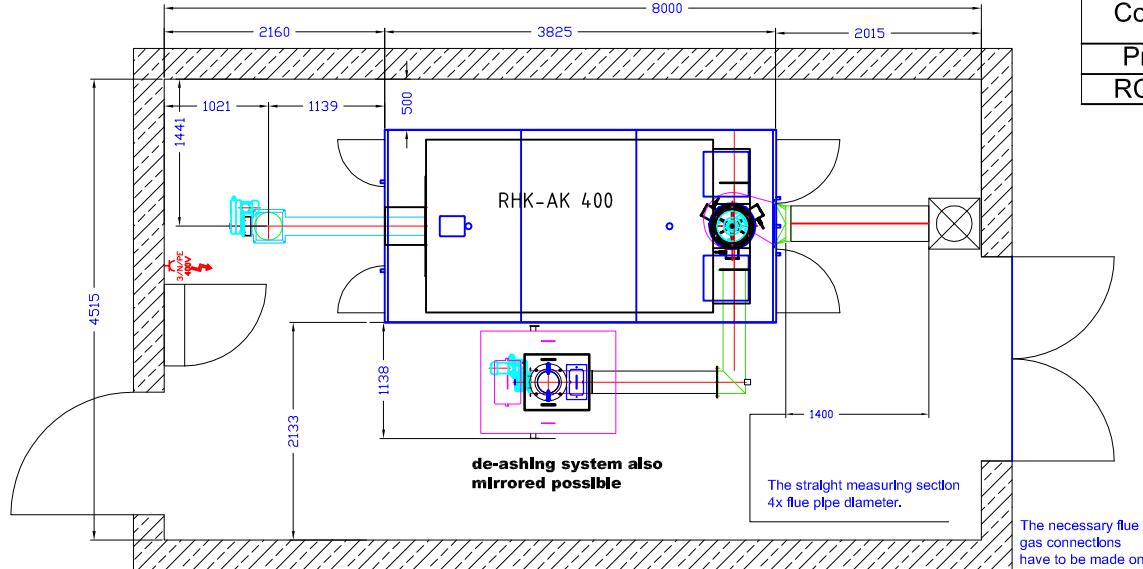


### Electrical connection data Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A $\Delta N$ 300mA

### Technical data RHK-AK 400 with e-filter

transport width (mm)	1692
transport length (mm)	3530
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3825
height with cover panel (mm)	2020
water content (l)	1580
weight (kg)	6200
heat exchanger surface ( $m^2$ )	33,75
continuous heat load (kW)	*360 / **320
*wood chips/ **pellets	
heating output (kW)	400
$CO_2$ (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,330000
flue gas temperature ( $^{\circ}C$ )	180
flue depress (PA)	28
flue depress with underpressure monitoring (PA)	10
drop at $dT 10$ pressure K (mbar)	162,30
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	350
min. opening for air supply ( $cm^2$ )	850
min. volume flow rate for return temp. increase at 15K ( $m^3/h$ )	7,64

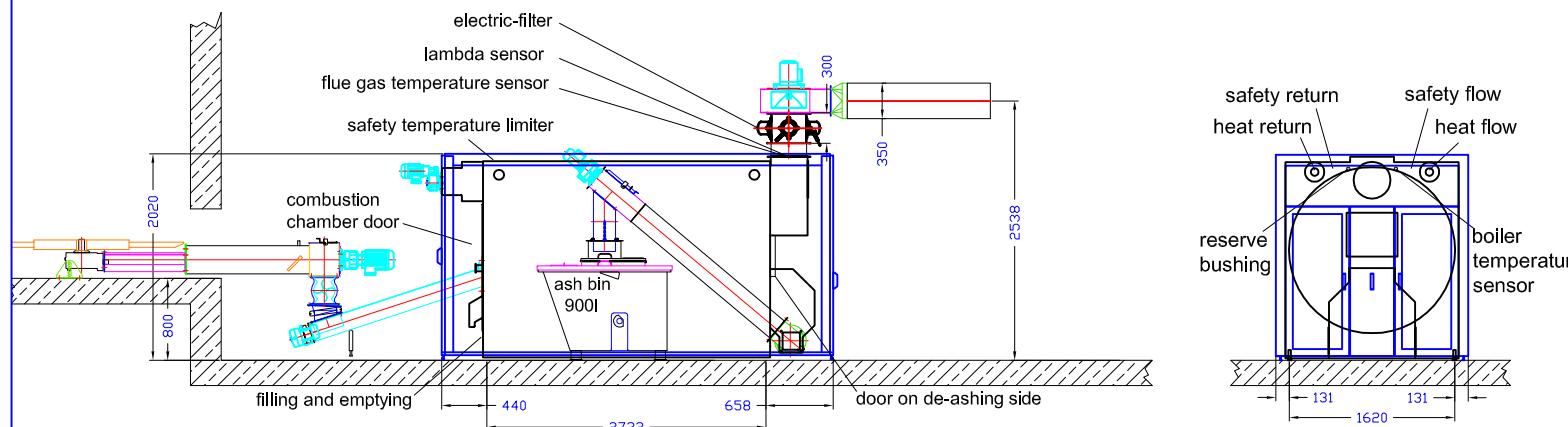

### Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

The boiler should be accessible from three sides. The discharging system should not cross the heating room.

Room height and position of the particle separator(s)\* should be discussed with the Heizomat team.


Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" \*.

Technical changes that serve the permanent further development remain reserved.

\*Optional equipment, depending on the statutory provisions for the country of destination.

**Electrical connection data**  
Boilers from 149 kW - 800 kW

Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A $\Delta N$ 300mA

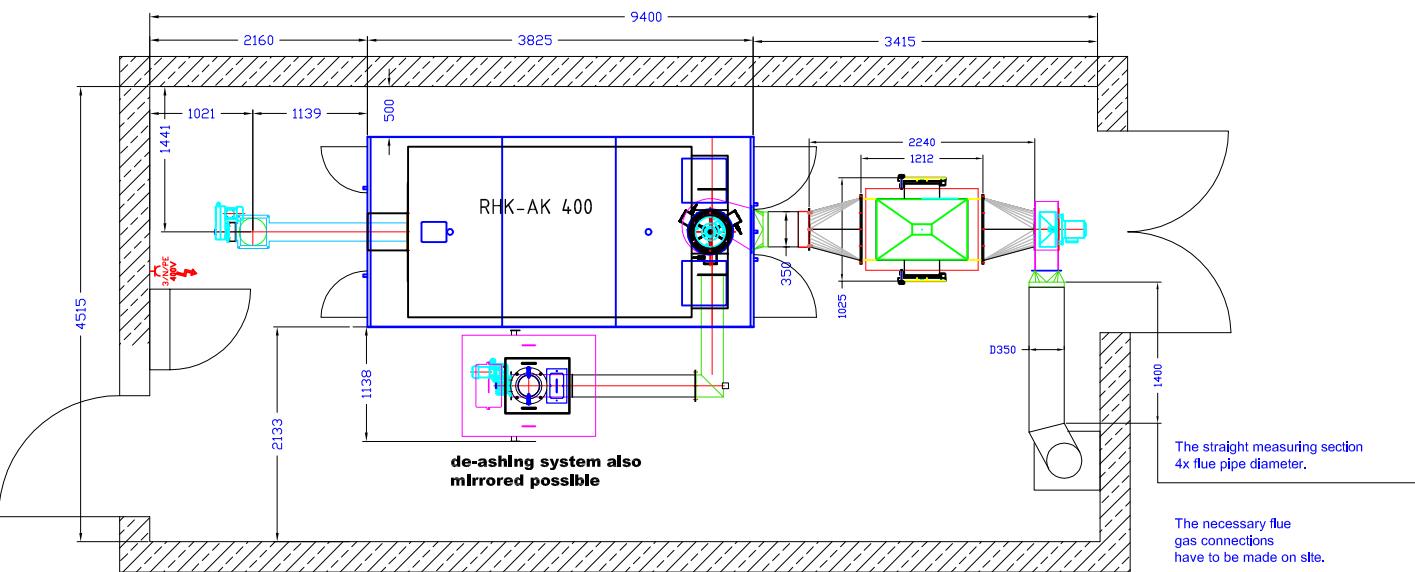

The boiler should be accessible from three sides. The discharging system should not cross the heating room.

Room height and position of the particle separator(s)\* should be discussed with the Heizomat team.

Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" \*.

Technical changes that serve the permanent further development remain reserved.

\*Optional equipment, depending on the statutory provisions for the country of destination.

Status 01.07.2017

**Technical data RHK-AK 400**  
e-filter and cyclone

transport width (mm)	1692
transport length (mm)	3530
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3825
height with cover panel (mm)	2020
water content (l)	1580
weight (kg)	6200
heat exchanger surface ( $m^2$ )	33,75
continuous heat load (kW) *wood chips/ **pellets	*360 / **320
heating output (kW)	400
$CO_2$ (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,330000
flue gas temperature ( $^{\circ}C$ )	180
flue depress (PA)	28
flue depress with underpressure monitoring (PA)	10
drop at $dT$ 10 pressure K (mbar)	162,30
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	350
min. opening for air supply ( $cm^2$ )	850
min. volume flow rate for return temp. increase at 15K ( $m^3/h$ )	7,64

**Technical data cyclone MC203**


transport width (mm)	1025
transport length (mm)	1212
transport height (mm)	2580
weight (kg)	700

**Technical data electric-filter**

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------




Heizomat GmbH Gerätebau- Energiesysteme  
Maicha 21 - 91710 Gunzenhausen - 09836/9797-0

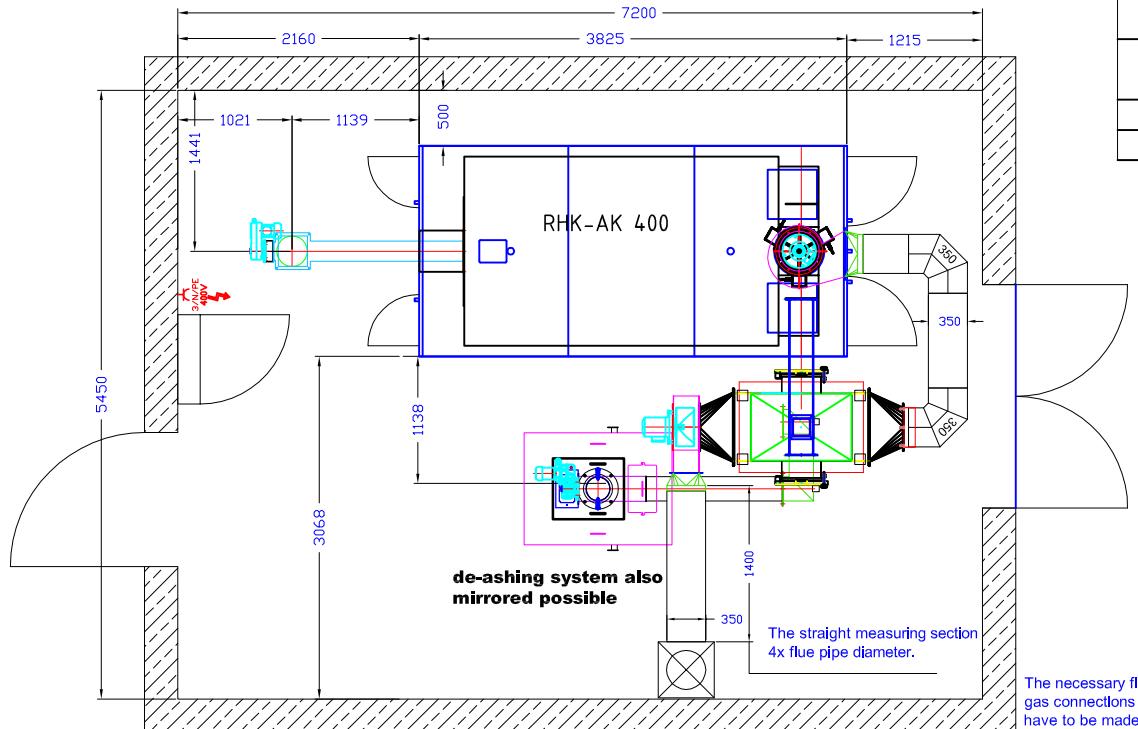

Electrical connection data Boilers from 149 kW - 800 kW	
Connection	Hardwiring 400V / 3N PE
Protection	C 32A
RCD switch	Type A IΔN 300mA

## Technical data RHK-AK 400 e-filter/ cyclone with de-ashing

transport width (mm)	1692
transport length (mm)	3530
transport height (mm)	1990
width with cover panel (mm)	1880
length with cover panel (mm)	3825
height with cover panel (mm)	2020
water content (l)	1580
weight (kg)	6200
heat exchanger surface (m <sup>2</sup> )	33,75
continuous heat load (kW)	*360 / **320
*wood chips/ **pellets	
heating output (kW)	400
CO <sub>2</sub> (%)	10,0
efficiency (%)	>90
flue gas mass flow (kg/s)	0,330000
flue gas temperature (°C)	180
flue depress (PA)	28
flue depress with underpressure monitoring (PA)	10
drop at dT 10 pressure K (mbar)	162,30
max. pressure (bar)	3
flow heat (DN)	80
heat return(DN)	80
safety flow (inch)	1 1/2
safety return(inch)	1 1/2
filling and emptying (inch)	1 1/4
thermowell (inch)	1/2
flue gas pipe diameter (mm)	350
min. opening for air supply (cm <sup>2</sup> )	850
min. volume flow rate for return temp. increase at 15K (m <sup>3</sup> /h)	7,64

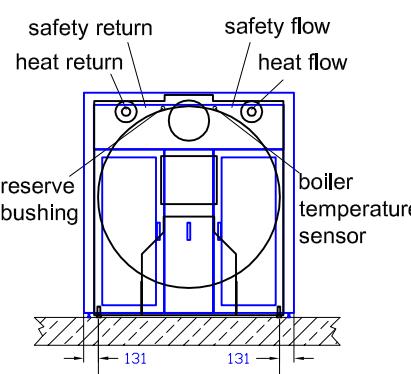

## Technical data cyclone MC203

transport width (mm)	1025
transport length (mm)	1212
transport height (mm)	2580
weight (kg)	700

## Technical data electric-filter

Heizoclean EF185, electrostatic	3x in flue pipe 350
------------------------------------	------------------------

**Heizomat**

The boiler should be accessible from three sides. The discharging system should not cross the heating room.

Room height and position of the particle separator(s)\* should be discussed with the Heizomat team.

Connecting points for the necessary potential equalization on the boiler see supplementary sheets "Connection of the Heizomat boiler system to the main potential equalization of a building" \*.

Technical changes that serve the permanent further development remain reserved.

\*Optional equipment, depending on the statutory provisions for the country of destination.